


# OWNER'S MANUAL

RESIDENTIAL  
THERMOSTAT  
P/N P374-1800

## HEAT & COOL HEAT PUMP

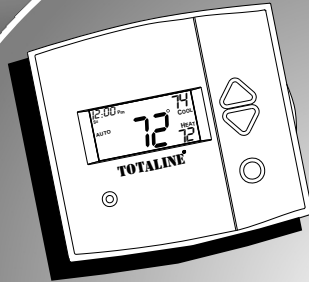

### 7-DAY PROGRAMMABLE DIGITAL THERMOSTAT



- 3 Configurable Outputs
- Control up to 3 Heat & 2 Cool Stages
- Adjustable 2nd & 3rd Stage Timers & Deadbands
- Backlit Display & Button Legends
- Outdoor Sensor Ready with High/Low Readouts for the Day
- Accepts Optional Humidity Module: Controls Humidification and Dehumidification
- Accepts EZ Programmer™
- Accepts Optional IR Remote Control
- Optional Internet / Phone Control Accessory
- Aux Heat Indicator

Accepts the **OPTIONAL HUMIDITY MODULE**

Meets Residential California Title 24

- Use with most Air Conditioning & Heating Systems including: 1 or 2 Stage Electric Cooling & 3 Stage Gas Heating, Heat Pump, Electric or Hydronic Heat.

**TOTALINE**

*Signature*

Replacement Components Division © Carrier Corporation 08/05

**TOTALINE**

 **CAUTION**

Follow the Installation Instructions before proceeding.  
Set the thermostat mode to "OFF" prior to changing  
settings in setup or restoring Factory Defaults.

 **CAUTION**


NEVER PUT MORE THAN ONE  
JUMPER ON THE SAME MISC  
JUMPER BLOCK!

THIS MAY DAMAGE YOUR  
THERMOSTAT AND VOID  
YOUR WARRANTY.



**NOTE:** Due to variations in environmental conditions, it is not  
always possible to achieve the desired humidification or  
dehumidification setpoint.

This device complies with Part 15 of the FCC Rules. Operation is  
subject to the following two conditions: (1) this device may not cause  
harmful interference, and (2) this device must accept any interference  
received, including interference that may cause undesired operation.



## How to Use This Manual

TOTALINE

The Table of Contents divides the thermostat features into sections making it easier to quickly find information.

The first page of each section contains a more detailed Contents of each section, such as the example page shown below.

**SECTION 14**  
*Timers and Deadbands* TOTALINE

**Section 14 Contents:**

- *Adjusting the Heat/Cool Differential.....14.2*
- *Adjusting the Cycles Per Hour.....14.3*
- *Adjusting the Deadband.....14.4*
- *Adjusting the Minutes of Run-Time Before the Next Stage.....14.6*
- *Selecting 2nd Stage Turn Off Temperature.....14.7*

Page 14.1

Annotations:

- Header shows section # and title of section
- Section contents
- Visible section tab on the side of the page
- Section and page #

In addition, this manual also has an Index to help you find any information regarding this thermostat quickly.

## Glossary of Terms

TOTALINE

**Auto-Changeover:** A mode in which the thermostat will turn on the heating or cooling based on room temperature demand.

**Configurable Output Jumper:** Using jumpers on the thermostat you can configure the MISC1, MISC2, and MISC3 terminals to operate with regards to humidification, dehumidification, 2nd stage cooling, 3rd stage heating, and a programmable output.

**Cool Setpoint:** The warmest temperature that the space should rise to before cooling is turned on (without regards to deadband).

**Deadband:** The number of degrees the thermostat will wait, once setpoint has been reached, before energizing heating or cooling.

**Dehumidify:** To reduce the amount of moisture in the air.

**Differential:** The forced temperature difference between the *heat setpoint* and the *cool setpoint*.

**Heat Setpoint:** The coolest temperature that the space should drop to before heating is turned on (without regards to deadband).

**Humidify:** To increase the amount of moisture in the air.

**Icon:** The word or symbol that appears on the thermostat display.

**Mode:** The current operating condition of the thermostat (i.e. Off, Heat, Cool, Auto, Program On).

**Non-Programmable Thermostat:** A thermostat that does not have the capability of running the *Time Period Programming*.

**Programmable Thermostat:** A thermostat that has the capability of running the *Time Period Programming*.

**Temperature Swing:** *Same as Deadband.*

**Time Period Programming:** A program that allows the thermostat to automatically adjust the *heat setpoint* and/or the *cool setpoint* based on the time of day.



## *Table of Contents*

### **TOTALINE**

<i>Getting to Know Your Thermostat</i>	<b>1</b>
<i>Quick Start</i>	<b>2</b>
<i>Setting Clock and Day</i>	<b>3</b>
<i>Basic Operation</i>	<b>4</b>
<i>Viewing Temperature and Humidity Sensors</i>	<b>5</b>
<i>Programming the Daily Schedule</i>	<b>6</b>
<i>Programming the Fan Operation</i>	<b>7</b>
<i>Thermostat Display Options</i>	<b>8</b>
<i>Humidification</i>	<b>9</b>
<i>Dehumidification</i>	<b>10</b>
<i>Viewing Equipment Run-Times</i>	<b>11</b>
<i>Electric Heat and Heat Pump Operation</i>	<b>12</b>
<i>Timers and Deadbands</i>	<b>13</b>
<i>Programming Remote Sensor Operation</i>	<b>14</b>
<i>Energy Save Operation</i>	<b>15</b>
<i>Programming the Run-Time Alarms</i>	<b>16</b>
<i>Programming the Vacation Mode</i>	<b>17</b>
<i>Configuring the MISC Outputs</i>	<b>18</b>
<i>Factory Defaults and Calibration</i>	<b>19</b>
<i>Accessories</i>	<b>20</b>
<i>Advanced Setup Table</i>	<b>21</b>

**SECTION 1**

*Getting to Know Your Thermostat*



**TOTALINE**

**1**


**Section 1 Contents:**

- *Front Panel Buttons*.....1.2
- *Display Features*.....1.3

*Front Panel*

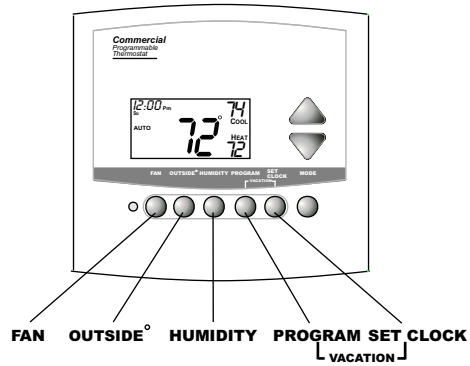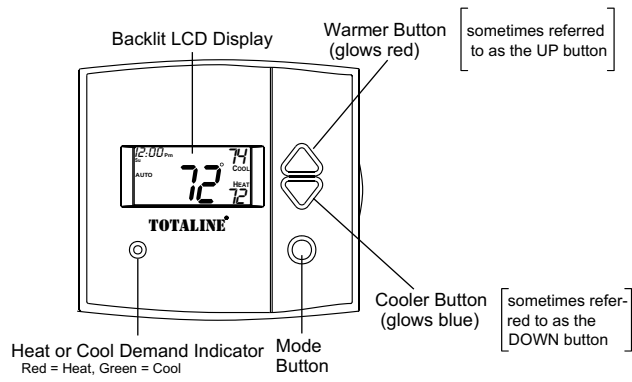


**1 Display Features**

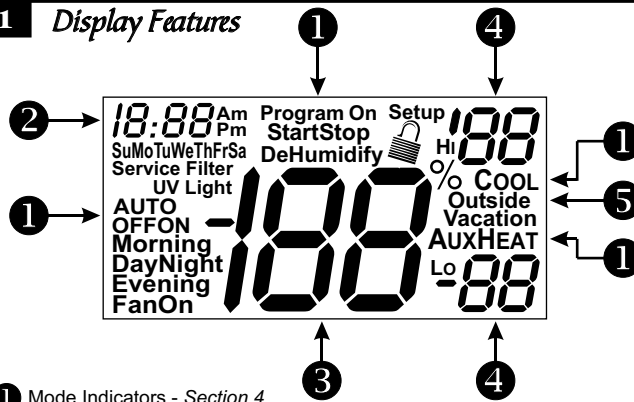


- 1** Mode Indicators - *Section 4*  
 Selects the operational mode of the equipment.  
**HEAT** - Indicates the heating mode.  
**COOL** - Indicates the air conditioning mode.  
**AUTO** - Indicates the system will automatically changeover between heat and cool modes as the temperature varies.  
**OFF** - Indicates heating and cooling is turned off.  
**PROGRAM ON** - Indicates the time period program is enabled to run.
- 2** Clock with Day of the Week - *Section 3*  
 Indicates the current time and day. This clock is also used to program the timer periods.
- 3** Room Temperature Display - *Section 5*  
 Indicates the current room temperature and displays the outside temperature when selected.
- 4** Desired Set Temperature - *Section 4/5*  
 Indicates desired room temperature(s). Also displays the daily maximum and minimum outside temperatures.
- 5** Outside icon - *Section 5*  
 Indicates the temperature displayed is from the optional outside sensor.

## Display Features

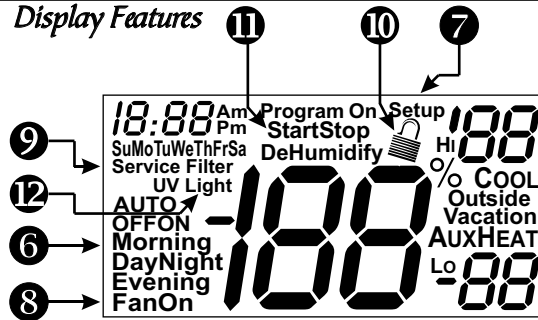

- 6** **Morning, Day, Evening & Night icons** - Section 6  
Indicates the day part of the time period program.
- 7** **Setup icon** - Sections 6-17  
Indicates the thermostat is in the setup mode.
- 8** **Fan On icon** - Section 7  
Indicates constant, continuous fan operation.  
When **Fan On** is not lit - indicates the fan will only operate when necessary to heat or to cool.
- 9** **Service Filter icon** - Section 16  
Appears when the filter should be serviced under normal conditions.  
Adjustable from 0 - 1950 hours of blower operation.
- 10** **Lock icon** - Section 8  
Indicates the keypad has been locked.
- 11** **StartStop icon** - Section 6  
Appears when programming timer functions.
- 12** **UV Light icon** - Section 19  
Appears when the UV bulb should be serviced under normal conditions. Adjustable from 0 - 1990 days of operation.

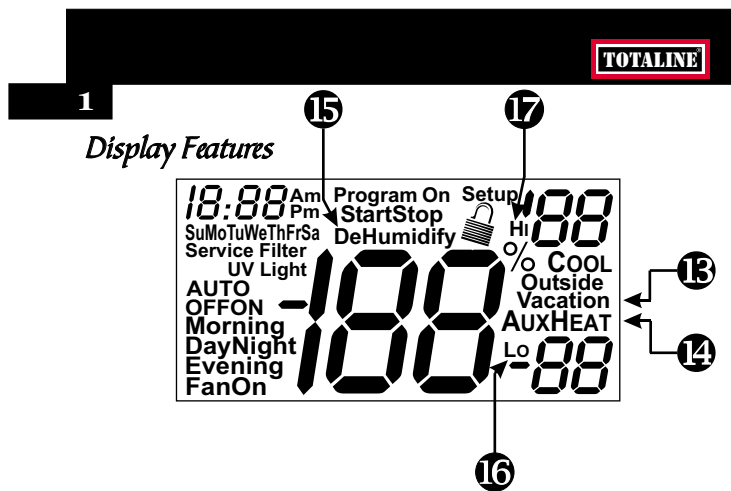


- 13** **Vacation** icon - *Section 17*  
 Indicates the thermostat has Vacation setpoints in use.
- 14** **AuxHeat** icon - *Section 12*  
 Indicates the Heat Pump is currently using 2nd stage electric strip heat.
- 15** **Humidify/DeHumidify** icon - *Sections 9/10*  
 Indicates the system is currently humidifying/dehumidifying the air.
- 16** **Lo** icon - *Section 5*  
 Indicates the lowest recorded outside temperature for the day.
- 17** **Hi** icon - *Section 5*  
 Indicates the highest recorded outside temperature for the day.

**Section 2 Contents:**

- **Setting the Clock and Day.....2.2**
- **Selecting the Heat or Cool  
Mode.....2.3**
- **Selecting Your Desired  
Temperature.....2.4**
- **Using the Fan Button.....2.4**

*Note: Following the instructions in this section will allow you to operate your thermostat using the factory default settings. These settings are depicted in the illustrations throughout this manual.*

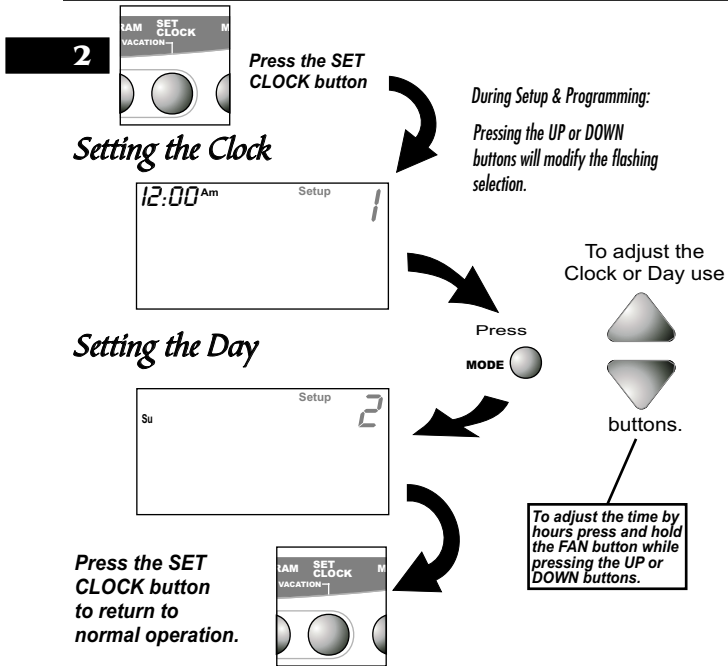


## Selecting the Heat or Cool Mode

2

### Select Mode by Pressing the MODE Button

**Heating Only**

The **HEAT** setting indicates the temperature the room has to reach before the furnace will turn on to heat the room.




**Cooling Only**

The **COOL** setting indicates the temperature the room has to reach before the air conditioner will turn on to cool the room.



**Heating or Cooling**  
**AUTO** will automatically select heat or cool based on room temperature demand.



**Time Schedule for Heating or Cooling**  
The **Program On** setting will activate the time period programming for the cooling or heating setpoint ONLY (Morning, Day, Evening & Night Periods).



**Off**  
**OFF** indicates both heating and air conditioning systems are turned off.



*Selecting Your Desired Temperature (adjusting the setpoints)*

**2 AUTO OR PROGRAM MODE**

Pressing the UP or DOWN buttons in Auto or Program mode will adjust **both** the heat and cool set temperatures simultaneously.



Adjust the desired set temperature with the



buttons.

**HEAT OR COOL MODE**

Pressing the UP or DOWN buttons in Heat or Cool mode will adjust only the heat or cool set temperature.



Adjust the desired set temperature with the



buttons.

*Using the Fan Button*



**Fan On** indicates constant fan operation. You may turn the fan on even if the thermostat is in the **Off** mode. Pressing the FAN button toggles this feature on or off.

**SECTION 3**  
*Setting the Clock and Day*




**3**

**Section 3 Contents:**

- *Setting the Clock*.....3.2
- *Setting the Day*.....3.2

*Note: During setup & programming pressing the UP or DOWN buttons will modify the flashing selection.*

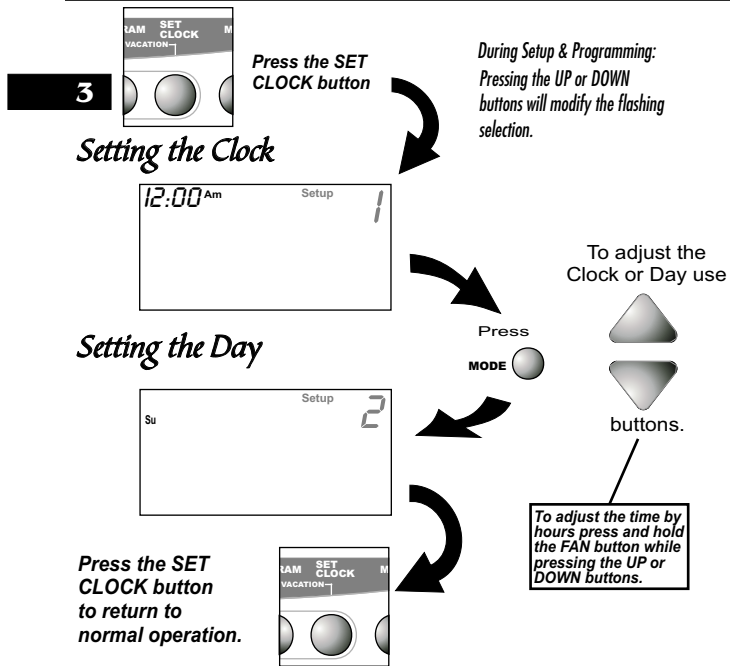

**Section 4 Contents:**

- *Programmable or Non-Programmable Thermostat.....4.2*
- *Manual or Auto-Changeover Thermostat.....4.3*
- *Selecting the Operating Mode....4.4*
- *Selecting Your Desired Temperature.....4.8*


**Note:** *During setup & programming pressing the UP or DOWN buttons will modify the flashing selection.*


## Programmable or Non-Programmable Thermostat

**4** When the very simplest operation is desired, this thermostat may be configured to be non-programmable, with or without Auto-Changeover. Follow the step below.


If 'NO' is selected, the thermostat will lockout the Program On screen; only the Off, Heat, Cool, and Auto screens may be accessed by pressing the MODE button.


Select 'YES' if you would like your thermostat to be **programmable**, then the Program mode will be accessible through the use of the MODE button. This is the default, factory setting.


**MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*

**PROGRAM** 

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

**YES**  Select Yes if you would like the thermostat to be programmable or No for non-programmable.

**NO** 




Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


### Manual or Auto-Changeover Thermostat


When the very simplest operation is desired, this thermostat may be configured to be a manual heat and cool thermostat, with or without time period programmability. Follow the step below.

4

The thermostat may be programmed to function as a Heat Only or Cool Only thermostat by selecting 'NO' in the setup screen below. This will lockout the Auto-Changeover screen and only allow the Off, Heat, Cool, and Program On screens to be accessed.


**MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*


**PROGRAM** 

**MODE**  *Press the MODE button repeatedly until this setup screen appears.*


*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

---

**YES**  Select Yes if you would like the thermostat to be Auto-Changeover or No for a Heat Only and Cool Only Thermostat.

**NO** 

YES Setup 2  
 AUTO

**Press PROGRAM** 

Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**Operating Mode when the Thermostat is Configured to be:**

**4**

NON-PROGRAMMABLE WITH MANUAL-CHANGEOVER - If the thermostat is configured to be a non-programmable thermostat with Manual-Changeover, the following screens will be available by pressing the MODE button.

**Select the Mode by Pressing the MODE Button**


**Heating Only**  
The **HEAT** setting indicates the temperature the room has to reach before the furnace will turn on to heat the room.



**Cooling Only**  
The **COOL** setting indicates the temperature the room has to reach before the air conditioner will turn on to cool the room.



**Off**  
**OFF** indicates both heating and air conditioning systems are turned off.

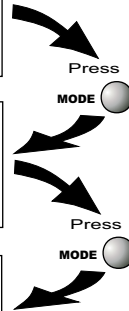

**Operating Mode when the Thermostat is Configured to be:**

NON-PROGRAMMABLE WITH AUTO-CHANGEOVER - If the thermostat is configured to be a non-programmable thermostat with Auto-Changeover, the following screens will be available by pressing the MODE button

**Select the Mode by Pressing the MODE Button**

**Heating Only**  
The **HEAT** setting indicates the temperature the room has to reach before the furnace will turn on to heat the room.




**Cooling Only**  
The **COOL** setting indicates the temperature the room has to reach before the air conditioner will turn on to cool the room.



**Heating or Cooling**  
**AUTO** will automatically select heat or cool based on room temperature demand.



**Off**  
**OFF** indicates both heating and air conditioning systems are turned off.

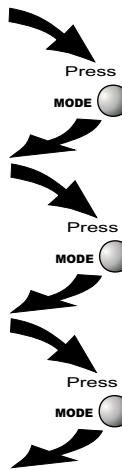

### Operating Mode when the Thermostat is Configured to be:


PROGRAMMABLE WITH MANUAL-CHANGEOVER - If the thermostat is configured to be a programmable thermostat with Manual-Changeover, the following screens will be available by pressing the MODE button.

**4**

#### Select the Mode by Pressing the MODE Button

##### Heating Only

The **HEAT** setting indicates the temperature the room has to reach before the furnace will turn on to heat the room.




##### Cooling Only

The **COOL** setting indicates the temperature the room has to reach before the air conditioner will turn on to cool the room.




##### Time Schedule for Heating Only

The **HEAT Program On** setting will activate the time period program for the heating setpoint ONLY (Morning, Day, Evening & Night Periods).




##### Time Schedule for Cooling Only

The **COOL Program On** setting will activate the time period program for the cooling setpoint ONLY (Morning, Day, Evening & Night Periods).



##### Off

**OFF** indicates both heating and air conditioning systems are turned off.




### Operating Mode when the Thermostat is Configured to be:

PROGRAMMABLE WITH AUTO-CHANGEOVER - If the thermostat is configured to be a programmable thermostat with Auto-Changeover, the following screens will be available by pressing the MODE button.


4

#### Select the Mode by Pressing the MODE Button


**Heating Only**  
The **HEAT** setting indicates the temperature the room has to reach before the furnace will turn on to heat the room.




**Cooling Only**  
The **COOL** setting indicates the temperature the room has to reach before the air conditioner will turn on to cool the room.




**Heating or Cooling**  
**AUTO** will automatically select heat or cool based on room temperature demand.



**Time Schedule for Heating or Cooling**  
The **Program On** setting will activate the time period programming for the cooling or heating setpoint ONLY (Morning, Day, Evening & Night Periods).



**Off**  
**OFF** indicates both heating and air conditioning systems are turned off.



### Selecting Your Desired Temperature (adjusting setpoints)

#### AUTO OR PROGRAM MODE

4

Pressing the UP or DOWN buttons in Auto or Program modes will adjust **both** the heat and cool set temperatures simultaneously. For more information on this see page 13.2.



Adjust the desired set temperature with the



buttons.

---

#### HEAT OR COOL MODE

Pressing the UP or DOWN buttons in Heat or Cool modes will adjust only the heat or cool set temperature.



Adjust the desired set temperature with the



buttons.

**SECTION 5**  
*Viewing the Temperature and Humidity Sensors*

**TOTALINE**

**5**


**Section 5 Contents:**

- *Viewing the Outside*  
*Temperature.....5.2*
- *Viewing the Indoor*  
*Humidity.....5.3*

### Viewing the Outside Temperature

This requires an outside sensor (optional accessory) to be installed. To read the temperature from the Outside Sensor, press the OUTSIDE<sup>®</sup> button. The display will then show the current outside temperature along with the High and Low temperatures for the day. The day starts at 12:00 am.

**5**

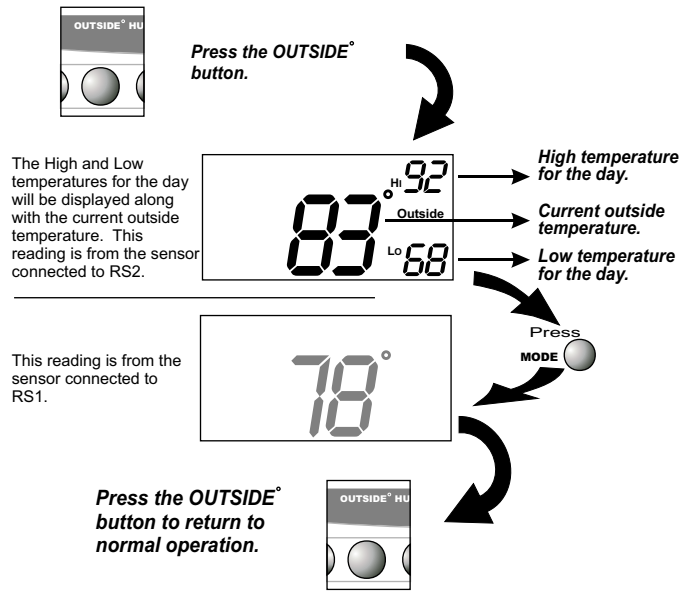


*Note: If no sensors are connected 2 dashes [- -] will appear on the display.*

### Viewing the Indoor Humidity

Requires the Humidity Module (optional accessory) to be installed. To display the current humidity at the thermostat, press the HUMIDITY button of the thermostat. The display will then show the current indoor humidity along with the humidification setpoint (Section 9).

5

**Note:** The humidity reading will not appear unless the Humidity Module has been installed. If a sensor has not been installed dashes will appear in place of the humidity reading.

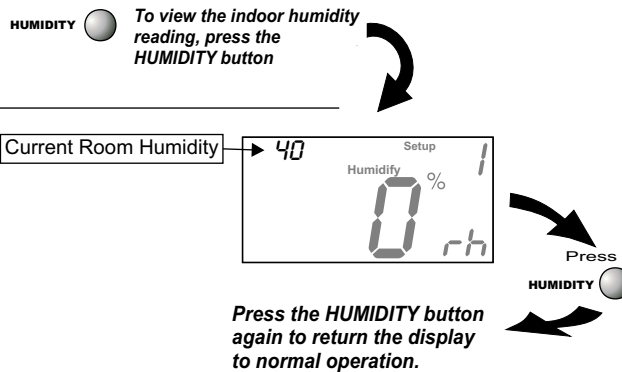

NOTE: Due to variations in environmental conditions, it is not always possible to achieve the desired humidification or dehumidification setpoint.

**SECTION 6**  
*Programming the Daily Schedule*

**TOTALINE**

**Section 6 Contents:**

<b>6</b>	■ <i>Programming a Daily Schedule.....</i>	<b>6.2</b>
----------	--	------------

## Programming a Daily Schedule



Press the PROGRAM button to enter time period programming.


Use the Programming Worksheet on the back cover to help with this section.





Select the day of week  
(Mo - Su)





6





Adjust the start time  
for Morning.



Adjust the cooling  
setpoint for Morning.  
(35° - 99°)




Adjust the heating  
setpoint for Morning.  
(35° - 99°)



Continued





Adjust the start time for Day.





6





Adjust the cooling setpoint for Day. (35°- 99°)





Adjust the heating setpoint for Day. (35°- 99°)




Adjust the start time for Evening.



Adjust the cooling setpoint for Evening. (35°- 99°)




Continued

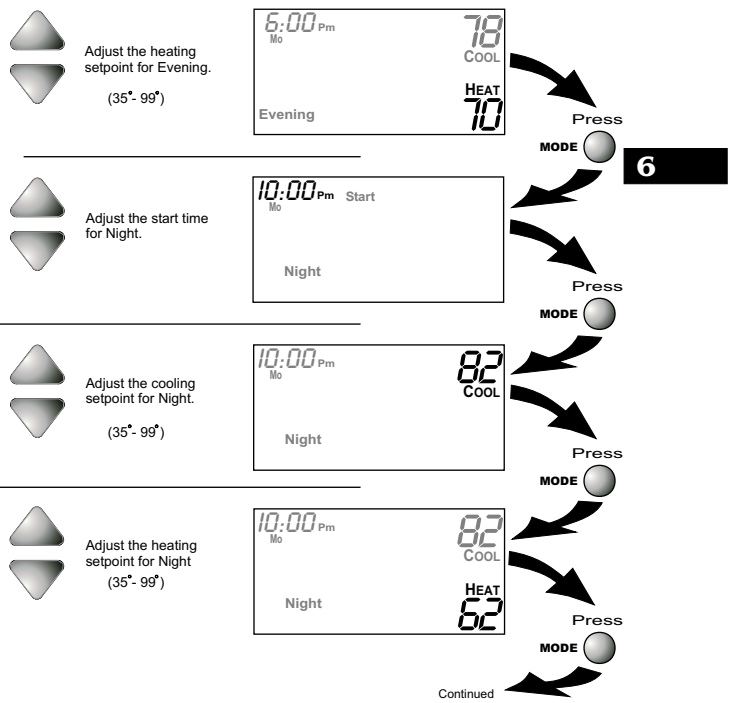



The copy command becomes available after programming the entire previous day.

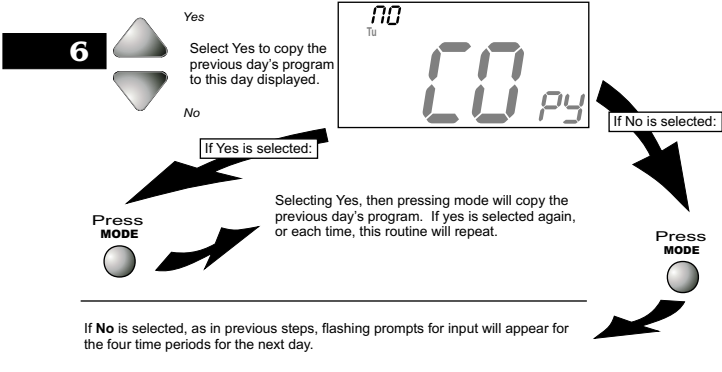

**Press PROGRAM** After programming for all seven days is complete, press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**SECTION 7**  
*Programming the Fan Operation*

**TOTALINE**

**Section 7 Contents:**

**7**

- *Using the Fan Button.....7.2*
- *Programming the Fan.....7.3*
- *Setting the Fan-Off Time  
Delay.....7.4*

### *Using the Fan Button*

When the fan is set for automatic operation it will energize any time there is a call for heating or cooling, otherwise the fan will remain off. Pressing the FAN button will energize the fan and display the **FanOn** icon on the thermostat display. To operate the fan in the automatic mode, press the FAN button again and the FanOn icon will disappear.

**7**

Press  
**FAN**

**Fan On** indicates constant fan operation. You may turn the fan on even if the thermostat is in the **Off** mode. Pressing the FAN button toggles this feature on or off.

## Programming the Fan

This timer will start the fan at the top of each hour and the fan will run for the number of minutes selected in step #3. Steps 4 & 5 restrict the hours during which the programmable fan may operate; step #4 is the start time and step #5 is the stop time. Selecting the same start and stop times will cause the fan to operate 24 hours a day.

**MODE** *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*

**PROGRAM**

**MODE** *Press the MODE button repeatedly until this setup screen appears.*

7

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

Adjust the Programmable Fan timer. 0 - 60 minutes. 0:00 = off

Setup 3

0:00

FanOn

Adjust the Programmable Fan start time. (step 4 appears only if step 3 is not 0:00)

Setup 4

7:00 Am Start

FanOn

Adjust the Programmable Fan stop time. (step 5 appears only if step 3 is not 0:00)

Setup 5

9:00 Pm Stop

OFF

FanOn

Press

Press


Press

Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


### Setting the Fan-Off Time Delay

To increase the cooling efficiency of your unit, the thermostat may be programmed to continue running the fan after a call for cooling has been satisfied. This delay may be set for 30, 60, or 90 seconds. If the Fan Off Delay is set for zero seconds, the fan will not energize after a call for cooling has been satisfied.

**7**

**MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*


**PROGRAM** 

**MODE**  *Press the MODE button repeatedly until this setup screen appears.*

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*



Set the Fan Off Delay to 0, 30, 60, or 90 seconds.



Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.




**SECTION 8**  
*Thermostat Display Options*



**Section 8 Contents:**



- *Turning On/Off the Backlight.....8.2*
- *Programming the Thermostat to Display Temperature in Fahrenheit or Celsius.....8.2*
- *Locking/Unlocking the Keypad.....8.3*

### Turning On/Off the Backlight

- MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.
- PROGRAM** 
- MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*



**8**


-  Select backlight operation:
- AUTO** - Light from 6pm to 6am nightly.
-  **ON** - Light continuously.
- OFF** - Light for 8 seconds after a button press.



Press 

### Programming the Thermostat to Display Temperature in Fahrenheit or Celsius


-  **C** Select thermostat operation in degrees Fahrenheit or Centigrade.
-  **F**





Press 

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

### *Locking/Unlocking the Keypad*

To prevent unauthorized use of the thermostat, the front panel buttons may be disabled. To disable, or 'lock' the keypad, press and hold the MODE button. While holding the MODE button, press the UP and DOWN buttons together. The  icon will appear on the display, then release the buttons.

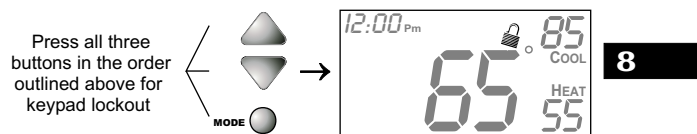

To **unlock** the keypad, press and hold the MODE button. While holding the MODE button, press the UP and DOWN buttons together. The  icon will disappear from the display, then release the buttons.

**Section 9 Contents:**

■ <i>Installing the Humidity Module.....</i>	<i>9.2</i>
■ <i>Configuring a Thermostat Output Jumper for Humidity Operation.....</i>	<i>9.3</i>
■ <i>Adjusting the Humidification Setpoint.....</i>	<i>9.4</i>

**NOTE:** *The humidification functions described in this section will only be available if a Humidity Module has been properly installed.*

**Disclaimer:**

*The manufacturer of this thermostat cannot be liable for misinstallation, improper connection or improper programming of the humidity functions of this thermostat that may result in water damage or mold growth.*

*Additionally, the manufacturer of this thermostat is not responsible for the fitness of the humidifier and/or installation of said humidifier connected to this thermostat. Furthermore, the maintenance of the humidifier components, including but not limited to, the filters and pads are not the responsibility of the thermostat manufacturer.*


*The Humidifier Service icon is only a suggestive reminder and should not take the place of the humidifier manufacturer's required maintenance requirements and schedule.*

### Installing the Humidity Module

To install the Humidity Module the thermostat must be detached from the back plate. Plug the Humidity Module into the Humidity Module connector as shown in Figure 2 below. Follow the detailed instructions included with the Humidity Module accessory. Once the Humidity Module has been installed, you must adjust the Humidity jumper setting to HUM as shown in Figure 1 below. This will allow you to access the humidification and dehumidification setup steps.


For proper humidity operation, this jumper must be set for HUM.

Figure 1




9

Back of P374-1800



Install the Humidity Module (see Humidity Module Instruction Sheet for more detailed information).


Figure 2

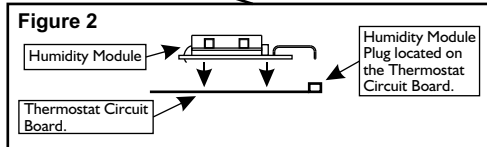

### Setting a Thermostat Output Jumper for Humidity Operation

To operate one of the MISC outputs using humidity-based operation, place the MISC1, MISC2, or MISC3 jumper on the terminal labeled HUM (see diagram below). This will supply 24VAC to the selected MISC terminal based on the humidification programming in the following pages. Only one of the three outputs (MISC1, MISC2, or MISC3) is required to have this jumper. For more information regarding the MISC1, MISC2, and MISC3 outputs, please see section 18.

**9** In the diagram below, the MISC3 jumper has been set for HUM (humidify) operation.

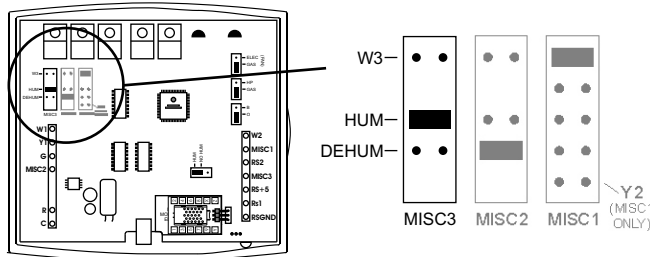

**IMPORTANT CAUTION**




**NEVER PUT MORE THAN ONE JUMPER ON THE SAME MISC JUMPER BLOCK!**  
**THIS MAY DAMAGE YOUR THERMOSTAT AND VOID YOUR WARRANTY**

### *Adjusting the Humidification Setpoint*

If your HVAC unit is equipped with a humidification system and the Humidity Module has been installed, the thermostat will provide power to the appropriate terminal on the backplate of the thermostat when the humidity in the home falls below the setpoint you have chosen. The value for this setpoint ranges from 0% to 60%.

NOTE: Due to variations in environmental conditions, it is not always possible to achieve the desired humidification or dehumidification setpoint.

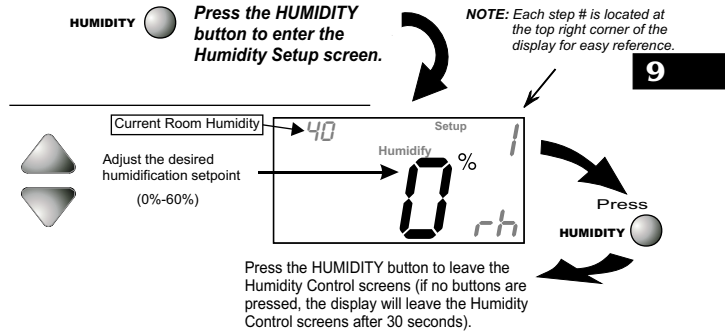

**Humidification Notes:** Press the button to set the humidity setpoint to 0% for no humidification operation.

You cannot set the dehumidify setpoint any lower than the humidify setpoint; a 5% differential is forced between the humidify and dehumidify setpoints.

**SECTION 10**  
*Dehumidification*

**TOTALINE**

**Section 10 Contents:**

- *Configuring a Thermostat Output Jumper for Dehumidification Operation.....10.2*
- 10** ▪ *Adjusting the Dehumidification Setpoint.....10.3*
- *Using Your Air Conditioner to Dehumidify.....10.4*
- *Using the DEHUM Terminal.....10.5*


*NOTE: The dehumidification functions described in this section will only be available if a Humidity Module has been properly installed. For instructions on installing the Humidity Module please see page 9.2.*

### Setting a Thermostat Jumper for Dehumidification Operation

To operate one of the MISC outputs using dehumidification-based operation, install the Humidity Module and place the Humidity Jumper on HUM (see page 9.2). Then place the MISC1, MISC2, or MISC3 jumper on the terminal labeled DEHUM (see diagram below). This will supply 24VAC to the selected MISC terminal based on the programming in the following pages. Only one of the three outputs (MISC1, MISC2, or MISC3) is required to have a jumper. For more information regarding the MISC1, MISC2, and MISC3 outputs, please see section 18.

In the diagram below, the MISC2 jumper has been set for DEHUM (dehumidification) operation.

**10**

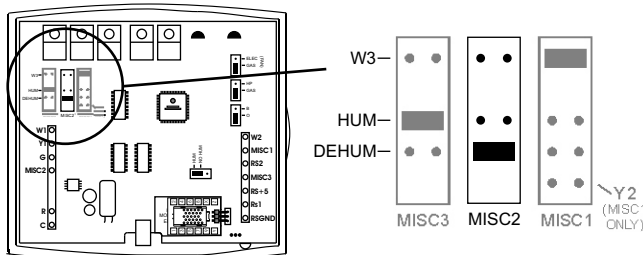

**IMPORTANT CAUTION**





**NEVER PUT MORE THAN ONE JUMPER ON THE SAME MISC JUMPER BLOCK!**  
**THIS MAY DAMAGE YOUR THERMOSTAT AND VOID YOUR WARRANTY**

## Adjusting the Dehumidification Setpoint

If your HVAC unit is equipped with a dehumidification terminal and the Humidity Module has been installed, the thermostat will provide power to the appropriate terminal on the backplate of the thermostat when the humidity in the home is above the setpoint you have chosen. When the indoor humidity rises above the setpoint you have selected, the appropriate terminal will be de-energized (see page 10.5). The value for this setpoint ranges from 25% to 99%.

NOTE: Due to variations in environmental conditions, it is not always possible to achieve the desired humidification or dehumidification setpoint.

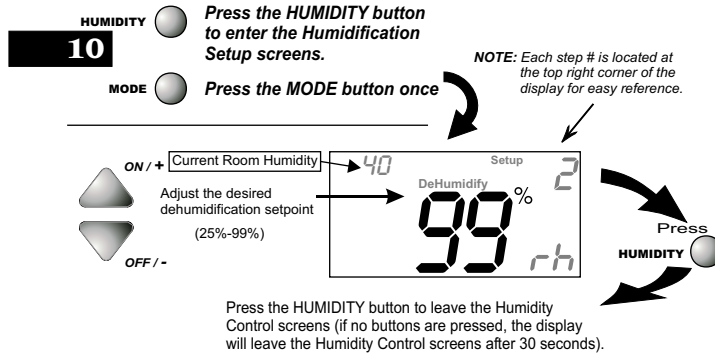



**Dehumidification Notes:** Press the  button to set the dehumidification setpoint to 99% for no dehumidification operation. This will lockout Advanced Setup steps 9 and 10 (see page 10.4).

You cannot set the dehumidify setpoint any lower than the humidify setpoint; a 5% differential is forced between the humidify and dehumidify setpoints.



## Using Your Air Conditioner to Dehumidify

If Cool to Dehumidify is ON the thermostat has the ability to initiate a cooling cycle for advanced dehumidification operation. When the thermostat detects the humidity percentage is above the setpoint for dehumidification, and heating or cooling is not on, the thermostat will force the compressor to run with the fan, thus reducing moisture in the air. This feature will also allow you to adjust the cooling overshoot of the setpoint, from 0° to 5° (adjustable in step #10). *For Example: If the cooling overshoot is set for 3°F and the cooling setpoint is set for 74°F, then as long as the room temperature reads between 71°F and 74°F this feature will energize the compressor and fan to dehumidify the air.*



- MODE**  **Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.**
  - PROGRAM**  **Press the MODE button repeatedly until this setup screen appears.**
- Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

**10**

**Steps 9 and 10 only appear if the Dehumidification setpoint is not 99% (see page 10.3).**



**Step 10 appears only if step 9 is set to "ON"**




Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


**Dehumidification Notes:** The thermostat must be in the Cool, Auto, or Program On mode for the Cool to Dehumidify feature to be available.


### Using the Dehum Terminal

If you configure a MISC output jumper for DEHUM, it may be programmed to operate in one of two ways:

- 1) **Normally Closed (NC):** The thermostat will de-energize the DEHUM terminal to allow the fan to run in low speed when there is a call for 1st stage cooling and the room humidity is greater than the dehumidification setpoint.
- 2) **Normally Open (NO):** The thermostat will energize the DEHUM terminal to allow the fan to run in low speed when there is a call for 1st stage cooling only and the room humidity is greater than the dehumidification setpoint.

**MODE**  *Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.*


**PROGRAM** 


**MODE**  *Press the **MODE** button repeatedly until this setup screen appears.*

*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

**NC** Normally Closed (NC) = DEHUM deenergized for low speed fan.

**NO** Normally Open (NO) = DEHUM energized for low speed fan.



Press 

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**Dehumidification Notes:** The DEHUM terminal will “release” and allow the fan to operate normally if there is call for 2nd stage cooling or if the call for Cooling and/or Cool to Dehumidify has been satisfied.

**SECTION 11**  
*Viewing Equipment Run-Times*

**TOTALINE**




**Section 11 Contents:**

- *Viewing the Humidifier  
Run-Time..... 11.2*
- *Viewing the UV Light  
Run-Time.....11.3*


**11**


### Viewing the Humidification Run-Time

After your humidification system has been operating for the number of days set in step #12 below, the Service Humidify icon will appear. This counter keeps track of the number of days since the Service Humidify icon was reset.

- MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM**
- PROGRAM**  button to enter Setup screens.
- MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

Press  Counts the number of days the humidifier has been running. Press **FAN** to reset the Service Humidify counter and remove the icon from the display.




**11**


Press 


Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

### Viewing the UV Light Run-Time


After the UV light has been operating for the number of days set in step #13 below, the Service UV Light icon will appear. This counter keeps track of the number of days since the UV light icon was last reset.


**MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*


**PROGRAM** 

**MODE**  *Press the MODE button repeatedly until this setup screen appears.*

**Note:** *Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

**11**  Counts the number of days since the UV Light was last reset. Press FAN to reset the Service UV Light counter and remove the icon from the display.

**Service UV Light**  **Setup 13**

**Press**  **PROGRAM**

Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**SECTION 12**  
*Electric Heat and Heat Pump Operation*

**TOTALINE**


**Section 12 Contents:**


- *Viewing the Heat Pump and Reversing Valve Jumper Setting..... 12.2*
- *Viewing the Electric Heat Jumper Setting..... 12.3*
- *Using Emergency Heat..... 12.4*

**12**

## Viewing the Heat Pump and Reversing Valve Jumper Settings

Steps 14 and 15 are 'Read Only' and may only be set with the jumpers on the circuit board of the thermostat.


**MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.


**MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

**12**  **ON** = Heat Pump operation  
**OFF** = Gas Electric operation



 Indicates that the thermostat jumper is set for an **O** reversing valve (energize in cooling) or a **b** reversing valve (energize in heating).





Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

### Viewing the Electric Heat Jumper Setting

Placing the jumper on ELEC will cause the thermostat to turn on the fan immediately any time there is a heat demand. Since most gas furnaces control the fan, this feature should be off unless the heater is only electric.

Step 16 is 'Read Only' and may only be set with the jumpers on the circuit board of the thermostat.

**MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.

**MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

**12**




**ON** indicates that the thermostat jumper is set for Electric Heat operation, or **OFF** for Gas/Electric or Heat Pump operation.



Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

## Using Emergency Heat

**ENTER EMERGENCY HEAT:** Only available if you have a Heat Pump installed. To initiate the Emergency Heat feature, press the FAN button. While holding the FAN button press the UP button. The Cool setpoint display will read 'EH' (emergency heat).

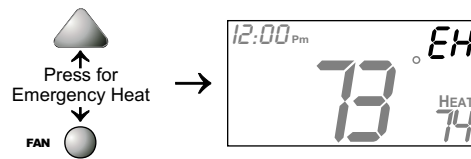

**12 OPERATION:** During Emergency Heat operation the thermostat will turn on the fan and the 2nd stage of heat when there is a demand for heat. Also during Emergency Heat the 1st stage of heating or cooling will be unavailable.


**EXIT EMERGENCY HEAT:** Follow the same steps as entering Emergency Heat by pressing the FAN and UP buttons. During Emergency Heat, only OFF and HEAT modes are available by pressing the MODE button.


**Section 13 Contents:**

- *Adjusting the Heat/Cool Differential.....13.2*
- *Adjusting the Cycles Per Hour.....13.3*
- *Adjusting the Deadband.....13.4*
- *Adjusting the Minutes of Run-Time Before the Next Stage.....13.6*
- *Selecting 2nd Stage Turn Off Temperature.....13.7*


## Adjusting the Heat/Cool Differential

The Heat and Cool setpoints will not be allowed to come any closer to each other than the value in this step. This minimum difference is enforced during Auto-Changeover operation.


**MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.

**MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

 Adjust the minimum **difference** between cooling & heating setpoints.  
(0°-6°)

**13**

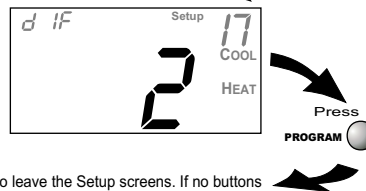



Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**Note:** To increase the spread between the heating and cooling setpoints, press the **MODE** button until only the heat setpoint is displayed. Adjust the desired setpoint. Press the **MODE** button until only the cool setpoint is displayed. Adjust the desired setpoint. Press the **MODE** button again to enter the Auto-Changeover mode where both the heat and cool setpoints are displayed.

### *Adjusting the Cycles Per Hour*

The Cycles Per Hour setting may limit the number of times per hour your HVAC unit may energize. For example, at a setting of 6 cycles per hour the HVAC unit will only be allowed to energize once every 10 minutes. The Cycles Per Hour limit may be overridden and reset by pressing any button on the thermostat.

**MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*

**MODE**  *Press the MODE button repeatedly until this setup screen appears.*

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*



Select the cycles per hour limit.  
 d=cycles per hour limit defeated.  
 d1=d + defeat 5 min. compressor lockout.  
 (d1, d, 2 - 6)



Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

### *Adjusting the Deadband*

MULTI-STAGE OPERATION - Controls up to three Heat and two Cool stages.

The **2nd Stage** of heat or cool is turned on when:

(A) The 1st Stage has been on for the time required (*step #22, page 13.6*). It is adjustable from 0-60 minutes and the default is two minutes.

**And**

(B) The temperature spread from the setpoint is equal to or greater than: *the setpoint plus the 1st stage deadband (step #19, next page), plus the 2nd stage deadband (step #20, next page)*. This 2nd stage deadband is adjustable from 0-10 degrees and the default is two degrees.


The **3rd Stage** of Heat is turned on when:

(A) The 2nd stage has been on for the time required (*step #23, page 13.6*). It is adjustable from 0-60 minutes and the default is two minutes.

**And**

**13**


(B) The temperature from the setpoint is equal to or greater than: *the setpoint plus the 1st stage deadband (step #19, next page), plus the 2nd stage deadband (step #20, next page) plus the 3rd stage deadband (step #21, next page)*. This 3rd stage deadband is adjustable from 0-10 degrees and the default is two degrees.

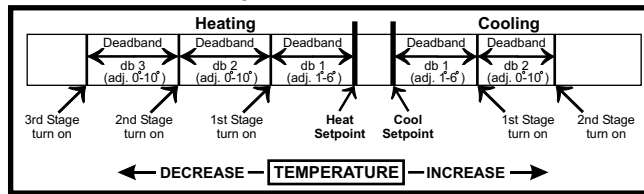


The above figure assumes the minimum on time for the prior stage has been met to allow the next stage to turn on, once the deadbands have been exceeded.













## Adjusting the Deadband

For more detailed information, please see the explanation on the previous page.

**MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.

**MODE**  Press the **MODE** button repeatedly until this setup screen appears.




*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

 Adjust the deadband for the 1st stage. (1° - 6°)		 Press <b>MODE</b>  <b>13</b>
 Adjust the deadband for the 2nd stage. (0° - 10°)		 Press <b>MODE</b> 
 Adjust the deadband for the 3rd stage. (0° - 10°)		 Press <b>PROGRAM</b> 

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

### *Adjusting the Minutes of Run-Time Before the Next Stage*



For more detailed information, please see the explanation on page 13.4.

- MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.
- PROGRAM** 
- MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*




Adjust the amount of time stage 1 must be on before stage 2 turns on.  
(0 - 60 min.)



**13**



Adjust the amount of time stage 2 must be on before stage 3 turns on.  
(0 - 60 min.)






Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


## Selecting 2nd Stage Turn Off Temperature


If ON is selected, the second stage of cooling or heating will remain energized until the thermostat reaches the setpoint on the thermostat display.

If OFF is selected, the second stage of cooling or heating will turn off after reaching the 1st stage deadband (see page 13.4 for more information).

- MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.
- PROGRAM** 
- MODE**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

**On**  Select On or Off:  
**On** - 2nd stage will remain on until setpoint is reached.


**Off**  **Off** - 2nd stage will turn off after reaching 1st stage deadband.

Setup 24

2nd

OFF

**13**

Press 

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**SECTION 14**  
*Programming Remote Sensor Operation*


**TOTALINE**


**Section 14 Contents:**

- *Installing the Remote  
Sensors.....14.2*
- *Controlling or Reading the  
Remote Temperature (RS1)...14.3*

### *Installing the Remote Sensors*

Up to two wired remote sensors may be installed on the thermostat to read outside temp (RS2) and/or control the temperature in another room (RS1). The designators RS1 and RS2 refer to the terminal locations on the thermostat's backplate. If a sensor is connected to RS1 and is programmed to control the thermostat, the degree icon on the thermostat will blink once per second to indicate that a remote sensor reading is being displayed. The wired sensor can be connected to the thermostat with **up to 150' of 18 ga., 300' of 20 ga., or 450' of 22 ga. unshielded, thermostat wire.**

 This wire **MUST** be completely separated from the thermostat or any other control wiring and must **NOT** be in the same conduit as high voltage wiring.

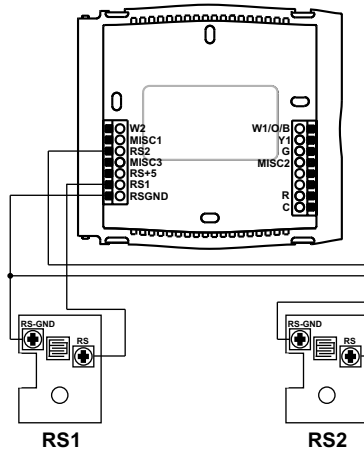


See the Remote Sensor accessory for further details.  
**Page 14.2**


### *Controlling or Reading the Remote Temperature (RS1)*

The thermostat may be programmed to only READ the remote sensor, or to CONTROL to the remote sensor. Advanced Setup step #25, below.

**Read Only Sensor (RS1):** If step #25 is set to only READ to the remote sensor, this temperature may be viewed by pressing the OUTSIDE<sup>o</sup> button on the thermostat and then pressing the MODE button.



**Control Sensor (RS1):** If step #25 is set to CONTROL to the remote sensor, the thermostat will ignore the reading of its internal temperature sensor and only display the temperature reading from the remote sensor. The degree icon on the thermostat will blink once per second to indicate that a remote sensor reading is being displayed. This is the factory default setting.

**14**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*


 *Press the MODE button repeatedly until this setup screen appears.*

*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

---

 YES  
 Optional Remote Sensor:  
**YES** = Read Only Remote Sensor RS1.  
 **NO** = Control to Remote Sensor RS1.

YES      Setup 25  
             Outside

 Press  
**PROGRAM**

Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


## SECTION 15 Energy Save Operation


TOTALINE

### How to Use the Energy Save Feature

If the thermostat is configured to be programmable (Section 4), and Energy Save has been selected in step #26 (below), the room will attempt to reach the selected comfort temperature at the exact time programmed into the thermostat. Energy Save only works when the thermostat enters the Morning mode from the Night mode.


For example, if the Night program is set for 11pm at 65°F heating and 85°F cooling, and the Morning program is set for 6am at 72°F heating and 75°F cooling, the thermostat will turn the system on before 6am in an effort to bring the temperature to its correct setting at exactly 6am. The P374-1800 learns from experience, so please allow 4-8 days after a program change or after initial installation to give Energy Save time to adjust to local weather, the construction of your home, and your heating and cooling system.

**MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.

**PROGRAM**  Press the **MODE** button repeatedly until this setup screen appears.

*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*

**15**

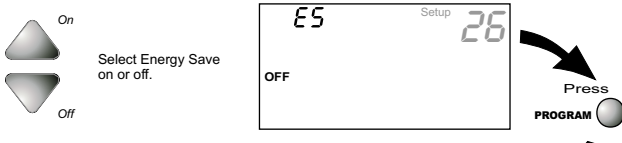

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

**SECTION 16**  
*Programming Run-Time Alarms*


**TOTALINE**


**Section 16 Contents:**


- *Setting and Resetting the Service Filter (Fan Run-Time) Alarm.....16.2*
- *Setting and Resetting the UV Light Run-Time Alarm.....16.3*
- *Setting and Resetting the Humidify Run-Time Alarm.....16.4*

### How to Set and Reset the Service Filter (Fan Run-Time) Alarm

This counter keeps track of the number of hours of fan run-time whether the fan is energized in the Heating or Cooling modes, or in stand alone fan operation. The Service Filter icon will appear after the preset number of hours of fan run-time in step #28 (below) has been achieved. Setting this counter to zero in step #28 will prevent the Service Filter icon from ever appearing.


**MODE**  **Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.**


**PROGRAM** 

**MODE**  **Press the MODE button repeatedly until this setup screen appears.**


*Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

---

**Hours the fan has run since last reset** 

**Press**  **FAN** **Reset the counter to 0 to remove the Service Filter icon from the display.**


**Setup 27**  
Service Filter

**Press**  **MODE** **16**

---

**Adjust the number of hours in increments of 50 the fan will run before the Service Filter icon appears on the display. 0 = off. (0 - 1950 hours)**



**Setup 28**  
Service Filter

**Press**  **PROGRAM**

**Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.**


## How to Set and Reset the UV Light Run-Time Alarm


This counter keeps track of the number of days since the UV Light counter has been reset. The UV Light icon will appear after the number of days has been achieved, as shown in step #29 (below). Setting the counter to zero in Step #29 will prevent the Service UV Light icon from ever appearing.


- MODE**  *Press the MODE button. While holding the MODE, press the PROGRAM button to enter Setup screens.*
  - PROGRAM**  *Press the MODE button repeatedly until this setup screen appears.*
- Note: Press the MODE button momentarily to move through the setup screens. Press and hold the MODE button to move backwards through the setup screens.*

**16**


Days since the UV Light icon has been reset


Press  Reset the counter to 0 to remove the Service UV Light icon from the display.



**MODE**  *Press the MODE button repeatedly until this setup screen appears.*

Adjust the number of days in increments of 10 before the UV Light icon appears on the display. 0 = off.  
(0 - 1990 days)






Press 

Press the PROGRAM button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.


## How to Set and Reset the Humidifier Run-Time Alarm

This counter keeps track of the number of days since the Service Humidify icon was last reset; this icon will appear after the number of days set in step #30 (below) has elapsed. Setting this counter to zero in step #30 will prevent the Service Humidify icon from ever appearing.


- MODE**  Press the **MODE** button. While holding the **MODE**, press the **PROGRAM** button to enter Setup screens.
- PROGRAM** 
- MODE**  Press the **MODE** button repeatedly until this setup screen appears.


*Note: Press the **MODE** button momentarily to move through the setup screens. Press and hold the **MODE** button to move backwards through the setup screens.*


Days since the last reset of the Service Humidify counter.


Press  **FAN**


Reset the counter to 0 to remove the Service Humidify icon from the display.




- MODE**  Press the **MODE** button repeatedly until this setup screen appears.

 Adjust the number of days in increments of 10 before the Service Humidify icon appears.  
0 = Off  
(0 - 1990 days)




Press  **PROGRAM**



**16**

Press the **PROGRAM** button to leave the Setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

 *The humidifier run-time alarm does not take the place of any humidifier manufacturer's recommended maintenance plan; it only serves as a helpful reminder.*

## SECTION 17 Programming Vacation Mode

**TOTALINE**

When the thermostat is programmed for Vacation mode, it will take effect at 12:00 am of the next day. The thermostat will control to the cooling and heating setpoints set in Vacation programming steps 2 and 3. Vacation setpoints will be enforced for the number of days specified in step #1.



Press the **SET CLOCK** button. While holding the **SET CLOCK** button, press the **PROGRAM** button to enter the Vacation programming setup steps.

<p>Select the number of days that the Vacation schedule will be in effect. A value of 0 disables Vacation mode.</p>		<p>Press <b>MODE</b></p>
<p>Adjust the cooling setpoint for Vacation mode. (35°- 99°)</p>		<p>Press <b>MODE</b></p>
<p><b>17</b></p> <p>Adjust the heating setpoint for Vacation mode. (35°- 99°)</p>		

Press the **PROGRAM** and **SET CLOCK** buttons to exit the setup screens. If no buttons are pressed, the display will leave the setup screens after 30 seconds.

You cannot set the Heat setpoint any higher than the Cool setpoint minus the deadband setting in Advanced Setup step #18 on page 13.2.

### *Programming Vacation Mode (continued)*

VACATION DISPLAY - When the thermostat is placed into the Vacation mode, the thermostat will display the screen shown below.



To return the thermostat to normal operation from Vacation mode, press the PROGRAM and SET CLOCK buttons and adjust the days in step #1 to zero (*see previous page*).

Press the PROGRAM and SET CLOCK buttons to return to normal operation.

**SECTION 18**  
*Configuring the MISC Outputs*


**TOTALINE**

**Section 18 Contents:**

- *Configuring the Jumpers.....18.2*
- *Explanation of Jumper  
Settings.....18.3*


### Configuring the Jumpers

For additional flexibility, your thermostat has three configurable outputs. These outputs are designed to have different functions depending on how the jumpers are set (*below*). Each output, labeled MISC1, MISC2, and MISC3 may be set for one of the five choices available. In the diagram below, the MISC3 jumper has been set for HUM\* (humidification) operation, the MISC2 jumper has been set for DEHUM\* (dehumidification) operation, and the MISC1 jumper has been set for W3 (3rd stage of heat) operation.

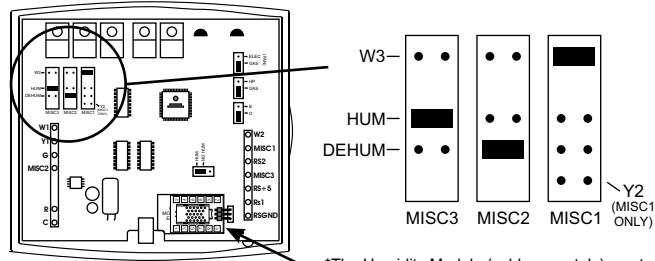

\*The Humidity Module (sold separately) must be installed to operate a humidification and/or dehumidification system.

**CAUTION**  
**NEVER PUT MORE THAN ONE JUMPER ON THE SAME MISC JUMPER BLOCK!**  
**DOING SO MAY DAMAGE YOUR THERMOSTAT AND VOID THE WARRANTY.**



## Explanation of Jumper Settings

### W3 JUMPER SETTING

If the jumper for MISC1, MISC2, or MISC3 is set to W3, the corresponding MISC screw terminal on the backplate will control a third stage of heat.


#### W3 MULTI-STAGE OPERATION EXPLAINED - SECTION 13

The **3rd Stage** of Heat is turned on when:

(A) The 1st and 2nd stages have been on for the time required (*steps #22 and #23, page 13.6*). It is adjustable from 0-60 minutes and the default is two minutes.

And

(B) The temperature from the setpoint is equal to or greater than: *the setpoint plus the 1st stage deadband (step #19, 13.5), plus the 2nd stage deadband (step #20, 13.5) plus the 3rd stage deadband (step #21, 13.5)*. This 3rd stage deadband is adjustable from 0-10 degrees and the default is two degrees.

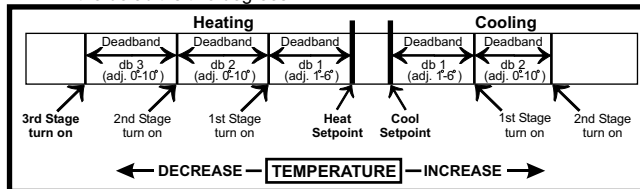

### HUM JUMPER SETTING

If the jumper for MISC1, MISC2, or MISC3 is set to HUM, the corresponding MISC screw terminal on the backplate will control a humidification system.

## 18 HUMIDIFICATION OPERATION - SECTION 9

If your HVAC unit is equipped with a humidification system and the Humidity Module (sold separately) has been installed, the thermostat will provide power to the MISC1, MISC2, or MISC3 terminal of the thermostat when the humidity in the home falls below the humidity setpoint you have chosen. The value for this setpoint ranges from 0% to 60%. If no humidity is desired or if a humidification system has not been installed, set the value to OFF.

## *Explanation of Jumper Settings (continued)*

### **DEHUM JUMPER SETTING**

*If the jumper for MISC1, MISC2, or MISC3 is set to DEHUM, the corresponding MISC screw terminal on the backplate will be connected to the dehumidification terminal of a furnace board.*  
**NOTE:** *Not all furnaces have a dehumidification terminal.*

#### DEHUMIDIFICATION OPERATION - SECTION 10

If your HVAC unit is equipped with a dehumidification system the thermostat will operate in one of two ways.

- 1) **Normally Closed (NC):** The thermostat will **de-energize** the MISC1, MISC2, or MISC3 terminal of the thermostat (this MISC terminal is connected to the DEHUM terminal on your furnace) to allow the fan to run in low speed when the humidity in the home is above the dehumidify setpoint you have chosen and there is a call for 1st stage cooling.
- 2) **Normally Open (NO):** The thermostat will **energize** the MISC1, MISC2, or MISC3 terminal of the thermostat (this MISC terminal is connected to the DEHUM terminal on your furnace) to allow the fan to run in low speed when the humidity in the home is above the dehumidify setpoint you have chosen and there is a call for 1st stage cooling.

*Explanation of Jumper Settings (continued)*

**Y2 JUMPER SETTING**

*If the jumper for MISC1 is set to Y2 the MISC1 screw terminal on the backplate will control a second stage of cooling.*

Y2 OPERATION - SECTION 13


Control up to two Cool stages.

The **2nd Stage** of heat or cool is turned on when:

- (A) The 1st Stage has been on for the time required (*step #22, page 13.6*). It is adjustable from 0-60 minutes and the default is two minutes.

**And**

- (B) The temperature spread from the setpoint is equal to or greater than: *the setpoint plus the deadband (step #20, page 13.5), plus the 2nd deadband (step #20, page 13.5)*. This 2nd deadband is adjustable from 0-10 degrees and the default is two degrees.

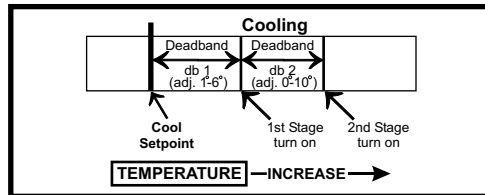

**SECTION 19**  
*Factory Defaults, Calibration, and Sensors*

**TOTALINE**

**Section 19 Contents:**

- *Resetting the Thermostat to the  
Factory Default Settings.....19.2*
- *Calibrating the Temperature  
and Humidity Sensors.....19.3*

### *Resetting the Thermostat to the Factory Default Settings (for default values see page 21.1)*


If, for any reason, you desire to return all the stored settings back to the factory default settings, follow the instructions below.

**WARNING: This will reset all Time Period and Advanced Programming to the default settings. Any information entered prior to this reset may be permanently lost.**

**1**

**MODE** 

Place the thermostat in the OFF mode.



**2**

**MODE** 

Press and hold the MODE button. While holding the MODE button, press and hold the FAN button for 5 seconds. All icons will appear on the display.


**FAN** 



**3**

**FAN** 

After all of the icons appear, release the MODE and FAN buttons. Then press and hold the FAN button for 5 seconds.




**19**

**4**

**MODE** 

After the letters Fd appear on the display (Factory Default), release the FAN button. Press the MODE button **once** to return to normal operation.




### Calibrating the Temperature and Humidity Sensors


Under normal circumstances it will not be necessary to adjust the calibration of the temperature and humidity sensors. If calibration is required, please contact a trained HVAC technician to correctly perform the following procedure.


**1**


**MODE**  Place the thermostat in the OFF mode.




**2**


**MODE**  Press and hold the MODE button. While holding the MODE button, press and hold the FAN button for 5 seconds. All icons will appear on the display.


**FAN** 





**3**


**PRESS**  **THERMOSTAT SENSOR**  
 Press the UP and DOWN buttons at the same time twice. The thermostat temperature will be displayed and may be calibrated using the UP or DOWN buttons.


**TWICE** 





**CALIBRATE**  


**4**


**MODE**  **REMOTE SENSOR**  
 Press the MODE button once. The remote sensor temperature will be displayed and may be calibrated using the UP or DOWN buttons. If a remote sensor is not installed, only dashes will appear.





**CALIBRATE**  

**5**

**MODE**  **HUMIDITY SENSOR**  
 Press the MODE button once. The relative humidity at the thermostat will be displayed and may be calibrated using the UP or DOWN buttons.



**CALIBRATE**  

After calibration is complete, press the MODE button **once** to return to normal operation.


## SECTION 20

### Accessories

TOTALINE

**ACCESSORY PORT** - The RJ11 Jack is used to connect the P374-1800 to the IR Receiver (P374-0431) for wireless communication or the EZ Programmer (P374-0432) for easy downloading or uploading of thermostat information.

*The Accessory Port is located on the bottom of the thermostat.*



**IR RECEIVER / REMOTE CONTROL** (optional accessory) - When the IR Receiver is connected, the thermostat can be controlled using an IR Remote Control. For more information see the instruction sheet for the IR Receiver P374-0431.

**EZ PROGRAMMER** (optional accessory) - When the EZ Programmer is connected, the thermostat Time Period Programming and Advanced Setup Programming can be stored into the EZ Programmer's memory. This information can then be uploaded to other thermostats. For more information see the instruction sheet for the EZ Programmer P/N P374-0432.

**WEB KIT** (optional accessory) - The P374-1800 Thermostat is capable of communication via the World Wide Web and phone by installing the optional Web Kit. Heating and cooling functionality may be accessed and controlled through the phone or internet. For more information contact your dealer.

## SECTION 21 Advanced Setup Table

**TOTALINE**

Step#	Description	Pg#	Range	Df *	Step#	Description	Pg#	Range	Df *
1	Programmable Thermostat	4.2	Yes/No	Yes	19	Deadband/Temp. Swing 1st Stage	13.5	1'- 6"	2"
2	Auto-Changeover Thermostat	4.3	Yes/No	Yes	20	Deadband/Temp. Swing 2nd Stage	13.5	0'- 10'	2"
3	Programmable Fan	7.3	0:00-0:60	0	21	Deadband/Temp. Swing 3rd Stage	13.5	0'- 10'	2"
4	Programmable Fan Start Time	7.3	24 Hour	7am	22	Minutes Between Stage 1 & 2	13.6	0-60min	2
5	Programmable Fan Stop Time	7.3	24 Hour	9pm	23	Minutes Between Stage 2 & 3	13.6	0-60min	2
6	Fan Off Delay	7.4	0, 30, 60, 90	0	24	2nd Stage turn off at setpoint	13.7	On/Off	On
7	Thermoglow Backlight	8.2	Auto/On/Off	Auto	25	Thermostat READ to RS1	14.3	Yes/No	Yes
8	F or C	8.2	F/C	F	26	Energy Save	15.1	Off/On	Off
9	Cool to Dehumidify	10.4	On/Off	Off	27	Reset Service Filter Icon	16.2	--	--
10	Maximum Dehum Overshoot	10.4	0'- 5"	3"	28	Service Filter Run Time Set	16.2	0 - 1950	0
11	DEHUM Terminal Polarity	10.5	NO/NC	NO	29	UV Light Run-Time Set	16.3	0 - 1990	0
12	Reset Service	11.2	--	--	30	Service Humidify Run-Time Set	16.4	0 - 1990	0
13	Humidify Icon	11.3	--	--					
14	Reset UV Light Icon	11.3	--	--					
15	Heatpump Jumper Setting	12.2	--	--					
16	Reversing Valve Jumper Setting	12.2	--	--					
17	Electric Heat Differential	12.3	--	--					
18	Minimum Heat/Cool Differential	13.2	0'- 6"	2"					
18	Cycles Per Hour	13.3	d1, d, 2-6	6					

**21**

\*Df = Factory Default Setting

**Alarms**

see *Run-Time*

**Auto**

adjust temperature,  
2.4, 4.8  
changeover, 1.3, 13.2,  
4.3, 4.5, 21.1  
differential, see  
*Differential*  
fan, 7.2  
icon, 1.3  
lockout, 4.3  
mode, 2.3

**AuxHeat icon, 1.5****b reversing valve, 12.2****Buttons**

down, 2.2, 2.4, 1.2,  
8.3, 19.3  
fan, 1.2, 2.4, 7.2, 12.4,  
19.2  
front panel, 1.2  
humidity, 1.2, 5.3,  
9.3, 10.3  
mode, 1.2, 2.3, 4.2,  
8.3, 19.2

outside, 1.2, 5.2  
program, 1.2, 4.2,  
6.2  
set clock, 1.2, 2.2,  
17.1  
up, 1.2, 2.2, 8.3,  
12.4  
vacation, 1.2, 17.1

**C, 8.2, 21.1****Calibration, 19.3****Celsius/Centigrade, 8.2****Clock**

display, 1.3  
setting, 2.2, 3.2

**Compressor Lockout, 13.3****Cool**

1st stage  
deadband, see  
*Deadband*  
dehum, 10.5  
minutes of run-  
time, 13.4,  
21.5, 24.1  
2nd stage  
deadband, see  
*Deadband*  
dehum, 10.5  
minutes of run-

time, 13.4, 18.5,  
21.1  
turn off  
temperature,  
13.7, 21.1  
Y2 operation, 18.5  
deadband, see  
*Deadband*  
droop, see *Deadband*  
electric/heat pump,  
12.2  
icon, 1.3  
indicator, 1.2  
mode, 2.3  
overshoot, see  
*Overshoot*  
program, see *Program*  
run-time, see *Run-Time*  
setpoint, 2.3-2.4,  
6.2-6.4  
to dehumidify, see  
*Dehumidify*

**Copy Function**  
see *Program***Cycles Per Hour, 13.3, 21.1****Day**

icon, 1.3  
programming, 6.3

setting, 1.3, 2.2

**Deadband**

1st stage, 13.4-13.5,  
18.3, 18.5, 21.1  
2nd stage, 13.4-13.5,  
13.7, 18.3, 18.5, 21.1  
3rd stage, 13.4-13.5,  
18.3, 21.1

**Dehumidify**

cool to, 10.4, 21.1  
icon, 1.5  
setpoint, 10.3

**Delay**

fan-off, see *Fan*  
time between stages,  
see *Time Delay*

**Differential**

heat and cool, 13.2,  
21.1  
dehumidify, 10.2  
humidify, 9.3

**Disabled Keypad**

see *Keypad Lockout*

**EH, 12.4****Electric Heating**

AuxHeat icon, 1.5  
jumper setting, 12.3  
21.1

**Emergency Heat,**

12.4

**Energy Save, 15.1****F, 8.2, 21.1****Factory Defaults**

caution, ii  
settings, 19.2  
resetting, 19.2

**Fahrenheit, 8.2****Fan**

button function, see  
*Buttons*  
off time delay, 7.3,  
21.1  
on during heat, see  
*Electric Heat*  
on icon, 1.4, 2.4, 7.2  
program, see  
*Programmable Fan*  
run-time, 19.2  
2nd stage heat, see  
*Emergency Heat*  
speed, see  
*Dehumidify*

**Fd, 16.2****Flashing Selection,**

2.2

**Gas Furnace**

control the fan, 12.3  
jumper, 12.3

**Green Indicator, 1.2****Heat**

1st stage  
deadband, see  
*Deadband*  
emergency heat,  
12.4  
minutes of run-  
time, 13.4, 18.5,  
21.1  
2nd stage  
deadband, see  
*Deadband*  
emergency heat,  
12.4  
electric strip heat,  
1.5  
minutes of run-  
time, 13.4, 18.3,  
21.1  
3rd stage  
deadband, see  
*Deadband*

W3, 18.3  
 AuxHeat icon, 1.5  
 deadband, see *Deadband*  
 droop, see *Deadband*  
 electric/heat pump,  
 12.2  
 icon, 1.3  
 indicator, 1.2  
 mode, 2.3  
 program, see *Program*  
 run-time, see *Run-  
 Time*  
 setpoint, 2.3-2.4,  
 6.2-6.4

**Heat Pump**  
 AuxHeat, 1.5  
 emergency heat,  
 12.4  
 jumper setting, 12.2

**Hi**  
 icon, 1.4, 5.2  
 temperature, 5.2

**Humidify**  
 icon, 1.5  
 service, 11.2, 16.4,  
 21.1  
 setpoint, 9.4



**IR Receiver, 20.1**  
**IR Remote Control,**

20.1



**Jumpers**  
 DEHUM, 18.3  
 ELEC, 12.3  
 electric heat, 12.3  
 gas electric, 12.2  
 heat pump, 12.2,  
 21.1  
 HUM, 9.2, 18.2-18.3  
 reversing valve, 12.2,  
 21.1  
 W3, 18.3  
 Y2, 18.2-18.3



**Keypad Lockout, 1.4,**  
**8.3**



**LCD, 1.2**  
**Locked Indication**  
 see *Keypad Lockout*  
**Lo**

icon, 1.4, 5.2

temperature, 5.2



**Manual**  
 changeover, 4.4, 4.6  
 cool, 4.3  
 heat, 4.3

**Maximum Outdoor  
 Temperature, see Hi**  
**Minimum Outdoor  
 Temperature,**  
 see *Lo*

**MISC**  
 jumper, see *Jumpers*  
 output, 18.2-18.5

**Mode icon, 1.3, 2.3**  
**Multi-stage  
 Operation, 13.4**



**Non-Programmable  
 Thermostat, 4.2,**  
**4.4-4.5**

**Normally  
 Open/Closed,**  
 dehum terminal,  
 10.5



**O Reversing Valve**,  
12.2  
**Off Mode**, 1.3, 2.3  
**Outdoor**,  
see *Outside*  
**Outside**  
button, see *Buttons*  
icon, 1.3  
sensor, 1.3, 5.2, 14.3  
viewing temperature,  
1.3, 5.2, 14.3, 19.4  
**Overshoot**, 10.3, 21.1



**Program**  
copy, 6.4-6.5  
daily schedule, 6.2-6.5  
mode, 1.4, 4.6-4.8  
On icon, 2.3  
worksheet, back page  
**Programmable Fan**  
7.3, 21.1  
**Programmable**  
**Thermostat**, 4.2



**Remote Sensor**  
calibrate, 19.3  
control to, 14.3-  
14.4, 21.1  
degree icon blink,  
14.2-14.3  
outside temperature,  
see *Outside*  
read to, 14.3  
viewing, 19.4, 21.1  
**Reset**  
thermostat settings,  
see *Factory Defaults*  
run-time  
fan/filter, 16.2,  
21.1  
humidify, 16.4,  
UV light, 16.3,  
21.1  
**RS1**, see *Remote*  
*Sensor*  
**RS2**, see *Outside*  
*Sensor*  
**Run-Time**  
resetting, see *Reset*  
setting,  
humidifier, 16.4,  
21.1  
service filter, 16.2  
21.1  
UV light, 11.3,

21.1



**Schedule**  
daily, see *Program*  
**2nd stage turn off**  
**temperature**,  
13.7, 21.1  
**Sensor**  
outside, see *Outside*  
remote, see *Remote*  
thermostat, see  
*Thermostat*  
**Service**  
filter icon, see *Reset*  
humidify icon, see  
*Reset*  
UV light, see *Reset*  
**Set Clock**, see *Clock*  
**Setpoint**  
cool, see *Cool*  
Dehumidification, 10.3  
heat, see *Heat*  
humidification, 5.3, 9.3  
**Setup Icon**, 1.4  
**Simplest Operation**,  
4.2-4.3



**Terminal, MISC,**  
see *MISC*

**Thermostat Sensor**  
calibrate, 19.3

**Time,** see *Clock*

**Time Delay,**  
compressor lockout,  
13.3  
cycles per hour,  
13.3, 21.1  
1st to 2nd stage,  
13.6, 21.1  
2nd to 3rd stage,  
13.6, 21.1

**Time Schedule,**  
see *Program*



**UV Light**  
icon, 1.4  
resetting, see *Reset*  
run-time, see *Run-Time*  
setting, see *Run-Time*



**Warranty, 23.1**



**Vacation,**  
button, see *Buttons*  
mode, 17.1-17.2  
programming, 17.1-  
17.2  
setpoints, 17.1

## SECTION 23

### Warranty

**TOTALINE**

One-Year Warranty - This Product is warranted to be free from defects in material and workmanship. If it appears within one year from the date of original installation, whether or not actual use begins on that date, that the product does not meet this warranty, a new or remanufactured part, at the manufacturer's sole option to replace any defective part, will be provided without charge for the part itself provided the defective part is returned to the distributor through a qualified servicing dealer.

THIS WARRANTY DOES NOT INCLUDE LABOR OR OTHER COSTS incurred for diagnosing, repairing, removing, installing, shipping, servicing or handling of either defective parts or replacement parts. Such costs may be covered by a separate warranty provided by the installer.

THIS WARRANTY APPLIES ONLY TO PRODUCTS IN THEIR ORIGINAL INSTALLATION LOCATION AND BECOMES VOID UPON REINSTALLATION.

LIMITATIONS OF WARRANTIES – ALL IMPLIED WARRANTIES (INCLUDING IMPLIED WARRANTIES OF FITNESS FOR A PARTICULAR PURPOSE AND MERCHANTABILITY) ARE HEREBY LIMITED IN DURATION TO THE PERIOD FOR WHICH THE LIMITED WARRANTY IS GIVEN. SOME STATES DO NOT ALLOW LIMITATIONS ON HOW LONG AN IMPLIED WARRANTY LASTS, SO THE ABOVE MAY NOT APPLY TO YOU. THE EXPRESSED WARRANTIES MADE IN THIS WARRANTY ARE EXCLUSIVE AND MAY NOT BE ALTERED, ENLARGED, OR CHANGED BY ANY DISTRIBUTOR, DEALER, OR OTHER PERSON WHATSOEVER.

ALL WORK UNDER THE TERMS OF THIS WARRANTY SHALL BE PERFORMED DURING NORMAL WORKING HOURS. ALL REPLACEMENT PARTS, WHETHER NEW OR REMANUFACTURED, ASSUME AS THEIR WARRANTY PERIOD ONLY THE REMAINING TIME PERIOD OF THIS WARRANTY.

THE MANUFACTURER WILL NOT BE RESPONSIBLE FOR:

1. Normal maintenance as outlined in the installation and servicing instructions or owner's manual, including filter cleaning and/or replacement and lubrication.
2. Damage or repairs required as a consequence of faulty installation, misapplication, abuse, improper servicing, unauthorized alteration or improper operation.
3. Failure to start due to voltage conditions, blown fuses, open circuit breakers or other damages due to the inadequacy or interruption of electrical service.
4. Damage as a result of floods, winds, fires, lightning, accidents, corrosive environments or other conditions beyond the control of the Manufacturer.
5. Parts not supplied or designated by the Manufacturer, or damages resulting from their use.
6. Manufacturer products installed outside the continental U.S.A., Alaska, Hawaii, and Canada.
7. Electricity or fuel costs or increases in electricity or fuel costs for any reason whatsoever including additional or unusual use of supplemental electric heat.
8. ANY SPECIAL INDIRECT OR CONSEQUENTIAL PROPERTY OR COMMERCIAL DAMAGE OF ANY NATURE WHATSOEVER. Some states do not allow the exclusion of incidental or consequential damages, so the above may not apply to you.

This warranty gives you specific legal rights and you may also have other rights which may vary from state to state.

## Programming Worksheet

see Section 6

DAY	PERIOD	START TIME	COOL	HEAT
MONDAY	Morning			
	Day			
	Evening			
	Night			
TUESDAY	Morning			<i>Copy Mon → Tue</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			
WEDNESDAY	Morning			<i>Copy Tue → Wed</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			
THURSDAY	Morning			<i>Copy Wed → Thu</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			
FRIDAY	Morning			<i>Copy Thu → Fri</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			
SATURDAY	Morning			<i>Copy Fri → Sat</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			
SUNDAY	Morning			<i>Copy Sat → Sun</i>
	Day			<input type="checkbox"/> No
	Evening			<input type="checkbox"/> Yes
	Night			



Printed on recycled paper.  
P/N 88-463 Rev. 2